



Procurement Office
495 Upper Falls Blvd.
Rochester, NY 14605
WWW.ROCHESTERHOUSING.ORG

Addendum #3

January 12, 2023

To: Potential Bidders

Re: Rochester Housing Authority

Fire Restoration- 43 & 60 William Warfield Drive
Four pages including this cover sheet

Acknowledgement:

**I have received the above referenced Addendum #3 and have used it in the calculation/
Preparation of this bid.**

Contractor

Without acknowledgement of this addendum, your bid may be non-responsive

BID ADDENDUM NO. (3)

01/10/2023

Rochester Housing Authority

Harriett Tubman Estates Unit 43 & 60 Fire Restoration

43 & 60 Williams Warfield Drive, Rochester, NY 14605

HUNT 2285-059

The following Addendum items shall be considered a part of the contract documents prepared by HUNT ENGINEERS, ARCHITECTS, LAND SURVEYORS & LANDSCAPE ARCHITECT, DPC. Bid Document date of 04/12/2022.

Additional Product Information issued by this Addendum:

N/A

Project Manual Sections issued by this Addendum:

N/A

Drawings issued by this Addendum:

AD3.1 – UNIT 60 MECH ROOM LAYOUT

AD3.2 – FURNACE EXHAUST VENT AT UNIT 60

Revision to Drawings Issued by this Addendum:

N/A

Revisions to Project Manual issued by this Addendum:

N/A

RFI addressed by this addendum:

RFI 1: Second Floor Wiring

Question RFI 1:

New work plan for the second floor of unit 60 shows new wiring in all the rooms. This would not be possible if the drywall in the rooms is not pulled.

Please confirm whether electrical rewiring is needed on the second floor.

Answer RFI 1:

The second floor is not required to be rewired other than what is noted in the bathroom. Main feeds from the panel in order to provide power to second floor circuits is to be provided.

RFI 2: Full Gypsum Board Demo

Question RFI 2:

Would RHA consider the complete drywall demo of both units 43 and 60 as it has it can expedite operations of rewiring and potentially the overall quality of finish.

Answer RFI 2:

Full demo of all the drywall throughout both units, 43 and 60 is not an option.

RFI 3: Extension of bid date

Questions RFI 3:

Would RHA consider extending bid date one week if these changes are made?

Answer RFI 3:

The bid opening date will be extended Per RHA Procurement.

End of Addendum 3


ACKNOWLEDGMENT OF RECEIPT BY:

LEGAL NAME OF BIDDER: _____

BY (Signature & Title): _____


DATE: _____

THIS PAGE SHALL BE ATTACHED TO AND SUBMITTED WITH THE BID PROPOSAL.

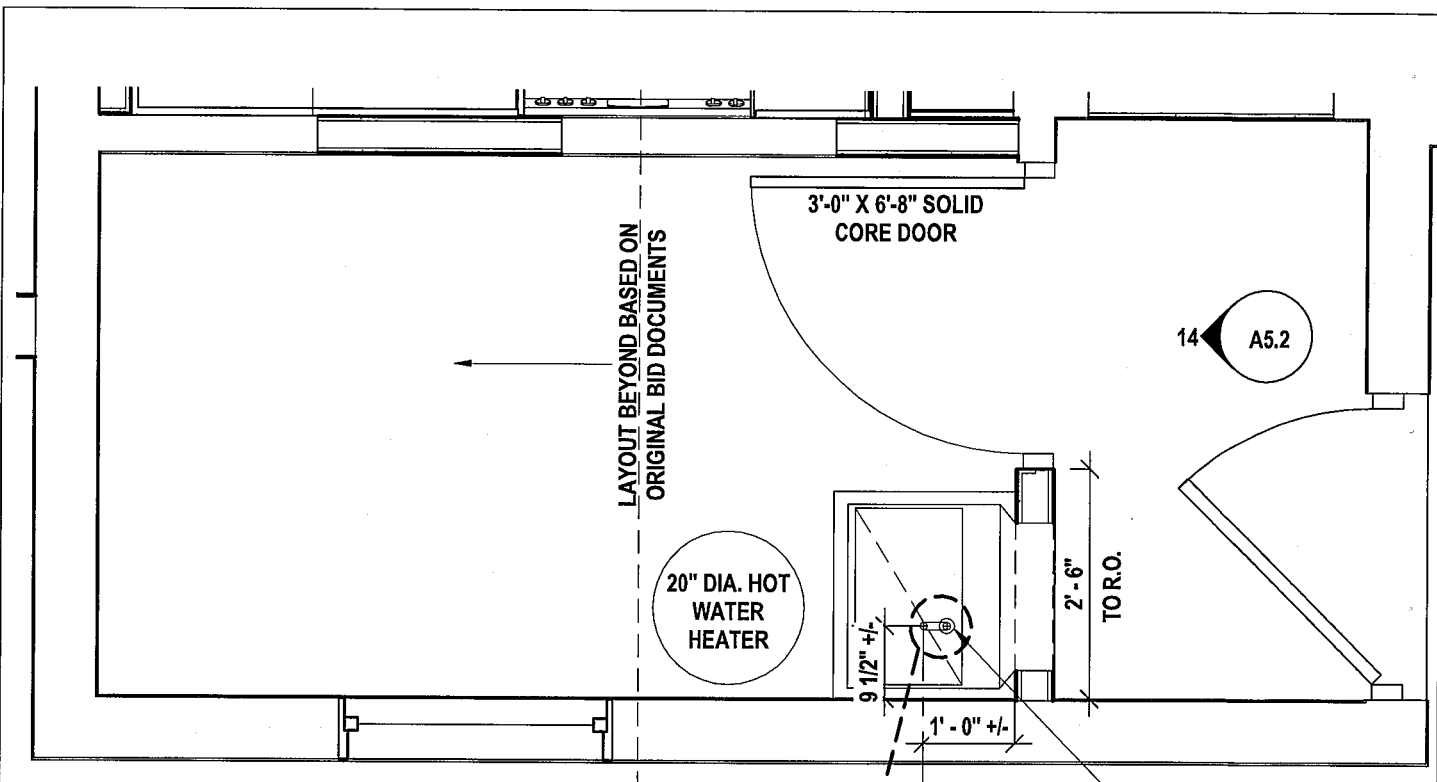

FURNACE TO PROVIDE
BOTTOM INTAKE WITH
THROUGH WALL LOUVER
VENT MEETING FURNACE
SPECIFICATION

EXISTING WATER
SERVICE

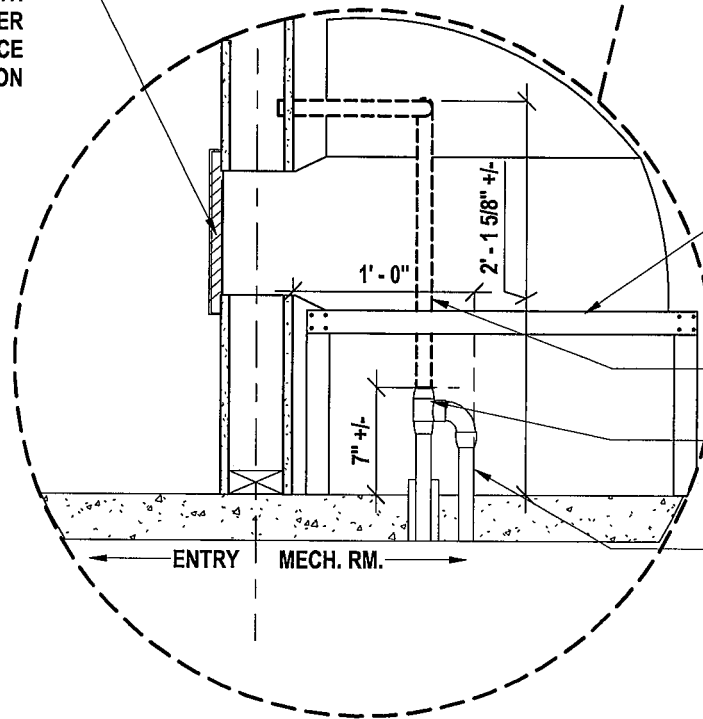

PROVIDE METAL FURNACE STAND
TO SUPPORT NEW FURNACE AND
PROVIDE CLEARANCES FOR WATER
SERVICE LINE


DEMO UPPER PORTION OF
WATER SUPPLY PIPING

PROVIDE NEW SHUT OFF AND
ROUTING TO CONNECT TO
DCW AS SHOWN ON P-1


EXISTING WATER SERVICE TO
BUILDING.

1 NEW WORK - UNIT 60 - MECH ROOM PLAN
1/2" = 1'-0"

<p>UNIT 60 MECH ROOM LAYOUT HARRIETT TUBMAN ESTATES UNIT 43 & 60 FIRE RESTORATION ROCHESTER HOUSING AUTHORITY 43 & 60 WILLIAMS WARFIELD DRIVE, ROCHESTER, NY 14605</p>	<p>HUNT ENGINEERS ARCHITECTS SURVEYORS HORSEHEADS, NY 607 - 358 - 1000 ROCHESTER, NY 585 - 327 - 7949 TOWANDA, PA 570 - 265 - 4868</p>	<p>AD-3.1 DATE: 01/08/23 PROJECT NO: 2285-059</p>
--	---	--

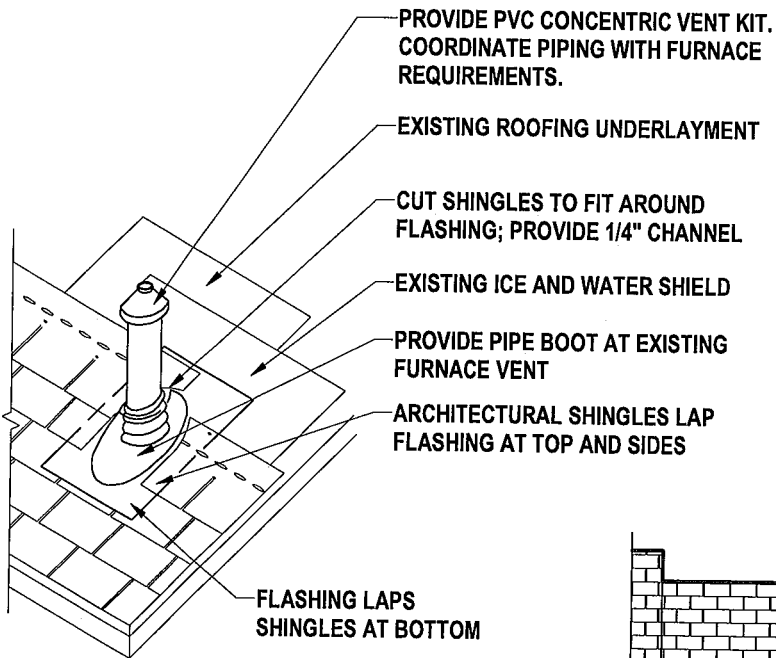

2 ROOF VENT DETAIL
1/2" = 1'-0"

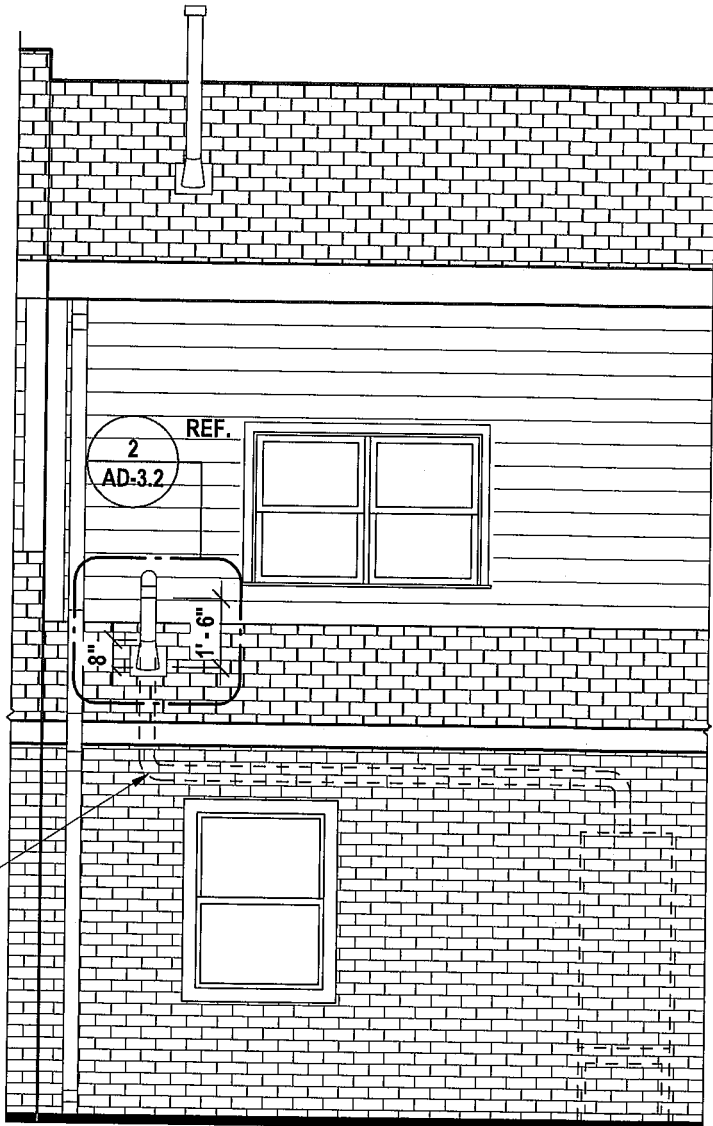

1 UNIT 60 FRONT ELEVATION
1/4" = 1'-0"

FURNACE EXHAUST VENT AT UNIT 60

HARRIETT TUBMAN ESTATES UNIT 43 & 60 FIRE RESTORATION

ROCHESTER HOUSING AUTHORITY

43 & 60 WILLIAMS WARFIELD DRIVE, ROCHESTER, NY 14605

COPYRIGHT © 2021

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
HORSEHEADS, NY 607 - 358 - 1000 ROCHESTER, NY 585 - 327 - 7949
TOWANDA, PA 570 - 265 - 4868

AD-3.2

DATE:
01/15/23

PROJECT NO:
2285-059